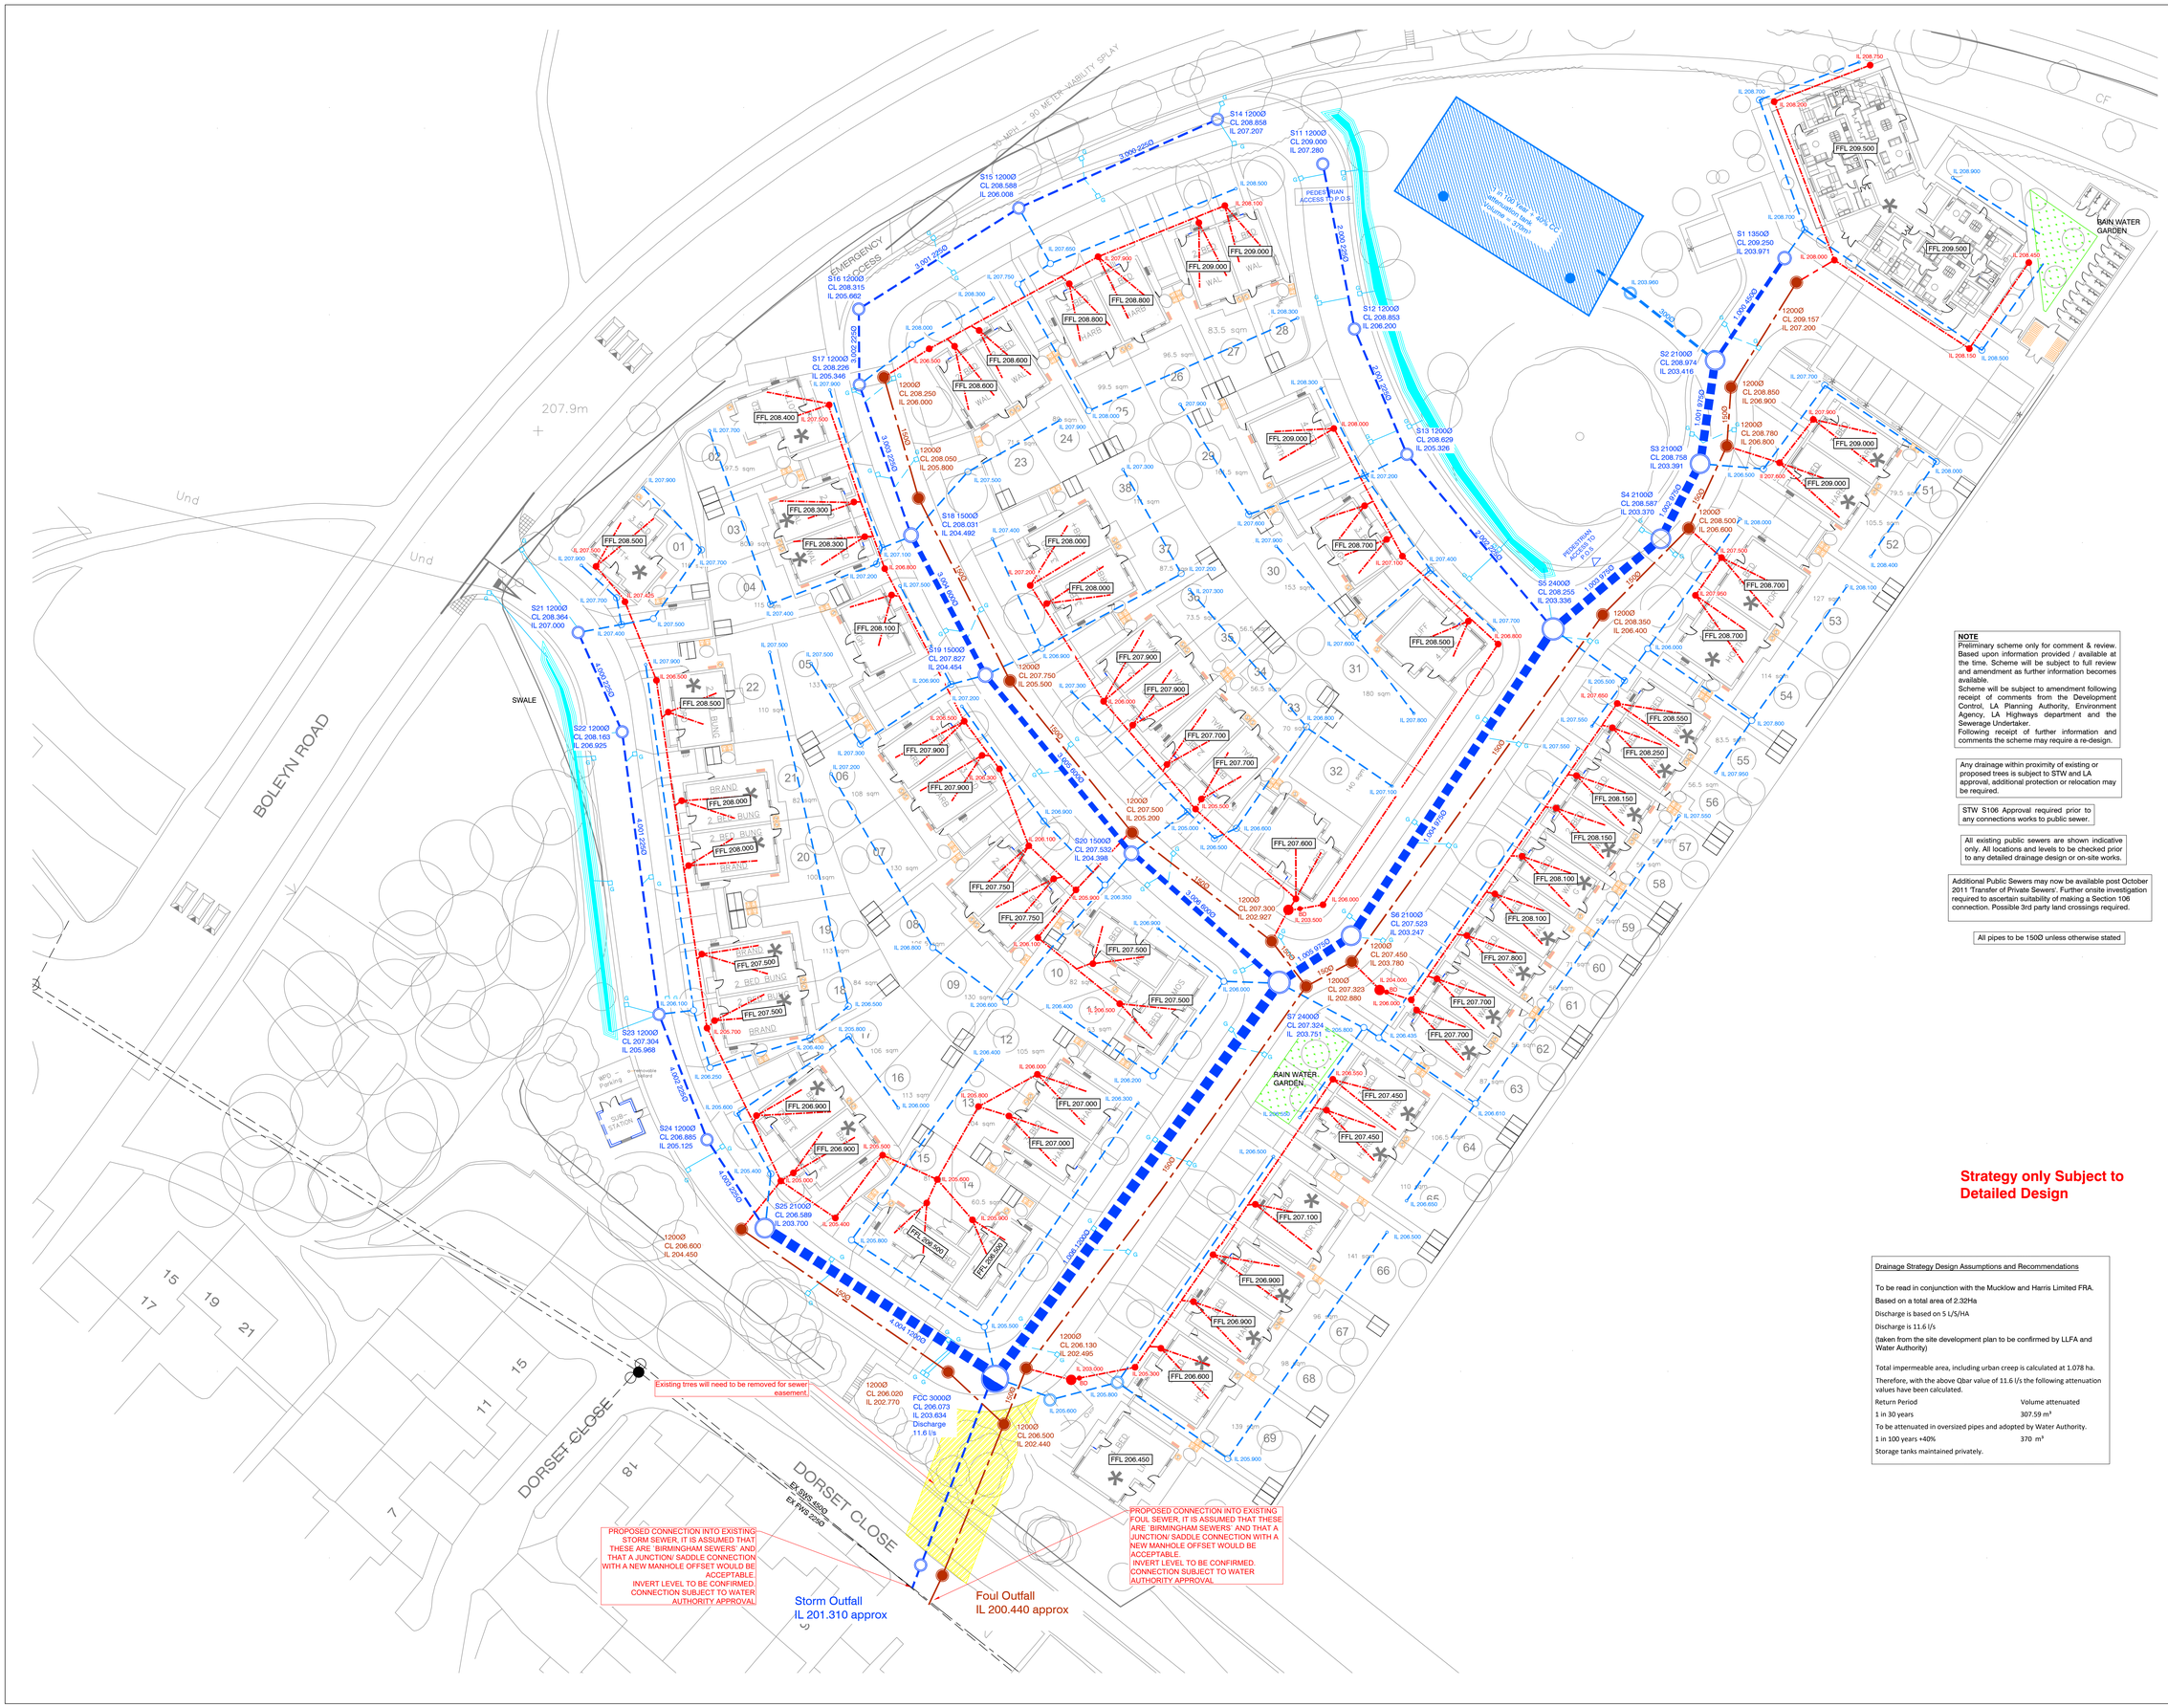

Notes

© This drawing is the copyright of the Engineers and may not be reproduced or used except by written permission.

Drawings must not be scaled. Work to figured dimensions only

1. Due to a change in legislation on 1st October 2011, there could be formally private sewers which have transferred over to the responsibility of the Sewerage Undertaker. If such sewers are located on site during construction works, please contact Mucklow & Harris Ltd so that a Section 185 Agreement can be prepared to divert these sewers.
2. The survey information used in the preparation of this drawing is not warranted. The contractor shall check all dimensions and levels on site.
3. This drawing must be read in conjunction with the site investigation report. Before work commences contractor should consult the engineer and the SI report regarding any contamination issues. All necessary Health and Safety measures to be taken.
4. Before work commences, the contractor shall liaise with all Statutory Authorities to determine the exact location of all apparatus and take all precautions deemed necessary to locate, protect and where necessary divert such equipment.
5. This drawing is subject to approval by Local Authority, Building Control, Sewerage Undertaker and the Environment Agency. Any works undertaken prior to the granting of these approvals is carried out at risk to others.
6. Should any surplus excavated material require disposal off site, it should be taken to a suitably licensed landfill site.
7. The contractor shall check all dimensions and levels on site.
8. Setting out to be confirmed by the Architect.
9. Prior to commencing work on the drainage, all existing drains, sewers manholes and services that remain shall be located, identified and a CCTV condition survey carried out. Where necessary, protection to the existing drainage infrastructure shall be provided.
10. All existing sewers and manholes abandoned due to the proposed works are to be either removed and suitably backfilled or grouted up.
11. All external drainage works shall be constructed in accordance with civil engineering specification for the water industry and Design Construction Guidance for adoptable drainage, for private drainage in accordance with the Building regulations Part H and BS EN 752.
12. All existing drainage levels, diameters & locations need to be checked on site prior to any drainage works, and any discrepancies need to be reported back to the Engineer.
13. Cover levels for manholes are approximate only and should be adjusted to match surrounding levels.
14. All manhole and drainage covers shall comply with BS EN124. Manhole covers within block paved area and buildings shall be recessed. Cover strengths to be:- Class B800 in areas of heavy loading.
    Class D400 in heavy trafficked areas (roads, services yards).
    Class C250 Lightly trafficked areas (car parks).
    Class B125 in landscape and non trafficked areas (min. 100mm dp frame).
    Manhole covers to be hinged and incorporate a locking mechanism.
15. Pipes to be :- Vitrified clay to BS EN 295 or Concrete to BS 5911 or UPVC pipes to BS EN 1452 or Thermoplastic Structured wall pipes complying with WIS 4-35-01 BSI Kitemarked. Class B/M/H nominal short term ring stiffness.
17. All pipes to be laid with soffits level, unless noted otherwise.
18. Where cover to pipes is less than 1200mm under carriageway - concrete bed and surround or concrete protection slab is required.
19. All pipes beneath buildings to be B&S in concrete. Where cover is less than 300mm the concrete is to be cast integrally with the floor slab.
20. Pipes Penetrating Walls.
    An opening is to be formed through walls to give pipes at least 50mm clearance all round. Pipes shall be supported by a lintel. Opening to be masked each side with rigid sheet material.
    Pipes embedded in walls shall have joints formed within 150mm of either wall face. Adjacent rocker pipes of max 600mm length with flexible joints shall continue the pipework.
21. Pipe runs near Buildings.
    If a trench is within 1m of a building it shall be filled with concrete up to the lowest level of the adjacent foundation. If a trench is greater than 1m from a building the trench shall be filled with concrete up to a level below the building equal to the distance from the building less 150mm.
22. Ventilation shall be provided at the head of the foul drainage runs.
23. Rainwater pipe to be 3m from any foul drainage runs.
24. Threshold drainage is required where levels fall towards a building entrance. Architect to confirm if not required.
25. Yard Gully positions are indicative, should be adjusted on site to suit levels.
26. All gully positions to suit low points and to be trapped.
27. Road gullies shall be trapped 450 diameter x 900mm deep with Class D 400 frame and grating to BS EN 124.
28. Drainage channel detailed design to be undertaken by manufactures. Alternative channels may be used, subject to Engineers approval.
29. All Concrete Manhole/chambers bases, surrounds etc to be in accordance with the BRE special digest 1 - Concrete in aggressive ground. Refer to site investigation report for sulphate requirements
30. All manholes, pipe trenches etc., to be backfilled with imported granular fill to Class 6P1-6P3 (Capping material) to (SHW) Table 6/1 & compacted in accordance with Table 6/4.
31. All pipelines shall be tested both before and after backfilling, using either air test or water test, in accordance with BS EN 1610.
32. Demarcation manholes and lateral drains need to be constructed in accordance with the Water UK/WRc "Design Construction Guidance".
33. All works to sewers/ manholes being offered for adoption or on existing public sewers should be in accordance with "Design Construction Guidance" and the Adopting Water Authority's recommendations.
34. Requirement for Land Drains to be assessed on site by the Site Manager.

NOTE
Preliminary scheme only for comment & review. Based upon information provided / available at the time. Scheme will be subject to full review and amendment as further information becomes available.
Scheme will be subject to amendment following receipt of comments from the Development Control, LA Planning Authority, Environment Agency, LA Highways department and the Sewerage Undertaker.
Following receipt of further information and comments the scheme may require a re-design.

Any drainage within proximity of existing or proposed trees is subject to STW and LA approval, additional protection or relocation may be required.

STW S106 Approval required prior to any connections works to public sewer.

All existing public sewers are shown indicative only. All locations and levels to be checked prior to any detailed drainage design or on-site works.

Additional Public Sewers may now be available post October 2011 'Transfer of Private Sewers'. Further onsite investigation required to ascertain suitability of making a Section 106 connection. Possible 3rd party land crossings required.

All pipes to be 150Ø unless otherwise stated

Strategy only Subject to Detailed Design

Drainage Strategy Design Assumptions and Recommendations

To be read in conjunction with the Mucklow and Harris Limited FRA.

Based on a total area of 2.32Ha

Discharge is based on 5 L/S/HA

Discharge is 11.6 l/s

(taken from the site development plan to be confirmed by LLFA and Water Authority)

Total impermeable area, including urban creep is calculated at 1.078 ha.

Therefore, with the above Qbar value of 11.6 l/s the following attenuation values have been calculated.

Return Period	Volume attenuated
1 in 30 years	307.59 m^3

To be attenuated in oversized pipes and adopted by Water Authority.

1 in 100 years +40%	370 m^3

Storage tanks maintained privately.

KEY

- Existing Storm Drain
- Existing Storm Drain Abandoned
- Existing Foul Drain
- Existing Foul Drain Abandoned
- Foul Drainage Offered for Adoption
- Foul Manhole Offered for Adoption
- Storm Drain
- Storm Inspection Chamber
- Storm Manhole
- Storm Drainage Offered for Adoption
- Storm Manhole Offered for Adoption
- Flow Control Chamber for Adoption
- Sewer Easement
- Permeable Paving
- Swale
- Rain Garden

REV	DATE	AMENDMENT	BY
C	13.02.23	Porous Paving removed at LLFA request	RAA
B	31.01.23	Updated to suit latest layout	ZH
A	05.09.22	Updated discharge rate and SuDs.	RAA

MUCKLOW & HARRIS
CONSULTING CIVIL & STRUCTURAL ENGINEERS

DRAWING STATUS: PRELIMINARY

CLIENT: Capita

PROJECT: Proposed Development at Boleyn Road, Rednal, Birmingham

TITLE: Drainage Strategy

DATE	DRAWN
13.04.21	RAA
SCALE 1:250 / SIZE A0	CHECKED AM

DRAWING NUMBER: 20131-102 | REVISION: C